


Pos.	Description
1	EXTERNAL UNIT HHP - SPLIT 1-PH OR 3-PH
2	IDU WH SPLIT
3	SYSTEM INTERFACE
4	LIGHT GATEWAY
5	EXTERNAL PROBE
6	UNDER FLOOR HEATING-COOLING
7	BY-PASS VALVE
8	HE KIT BELOW ODU + DRAIN PAN
9	KIT SHUT-OFF VALVE

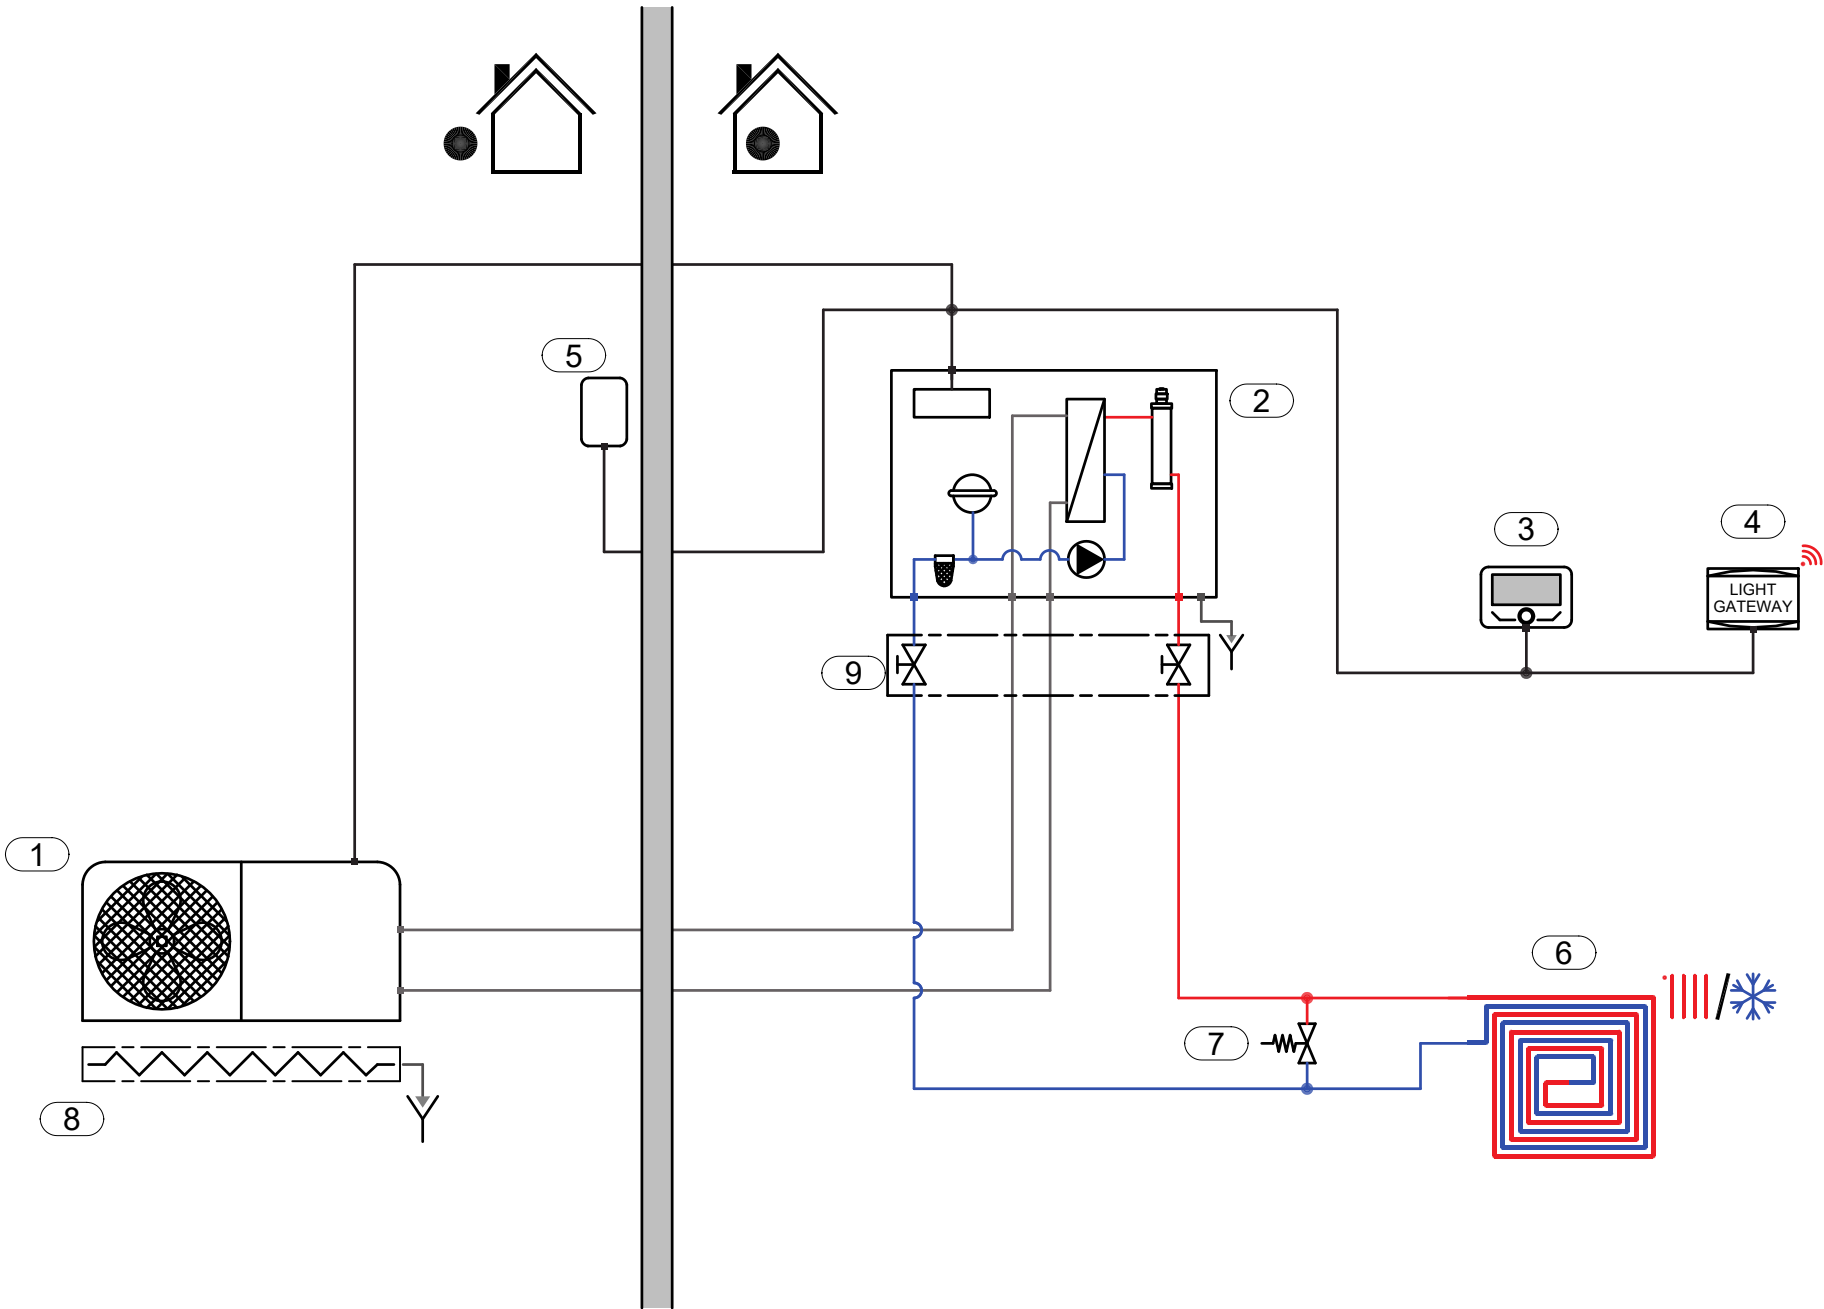


- This schematic has to be considered as example of the system functionality only and does not replace design by a qualified technician;
- The final schematic must be prepared respecting all the laws, norms and decrees in force, in order to facilitate a correct installation in compliance with the rule of the art;
- For the proper functioning of all system components, follow the instructions in the design, installation and user manuals provided by the manufacturer;
- This outline may be amended by the Ariston Group at any time without prior notice.

SCHEME		
Hydraulic		
DATE	REV.	PAGE
05/12/2023		1 / 4

SCHEME NAME

EN\_003\_PCM4.PL.S\_HC\_1D

Pos.	Description
1	EXTERNAL UNIT HHP - SPLIT 1-PH OR 3-PH
2	IDU WH SPLIT
3	SYSTEM INTERFACE
4	LIGHT GATEWAY
5	EXTERNAL PROBE
6	UNDER FLOOR HEATING-COOLING
7	BY-PASS VALVE
8	HE KIT BELOW ODU + DRAIN PAN
9	KIT SHUT-OFF VALVE

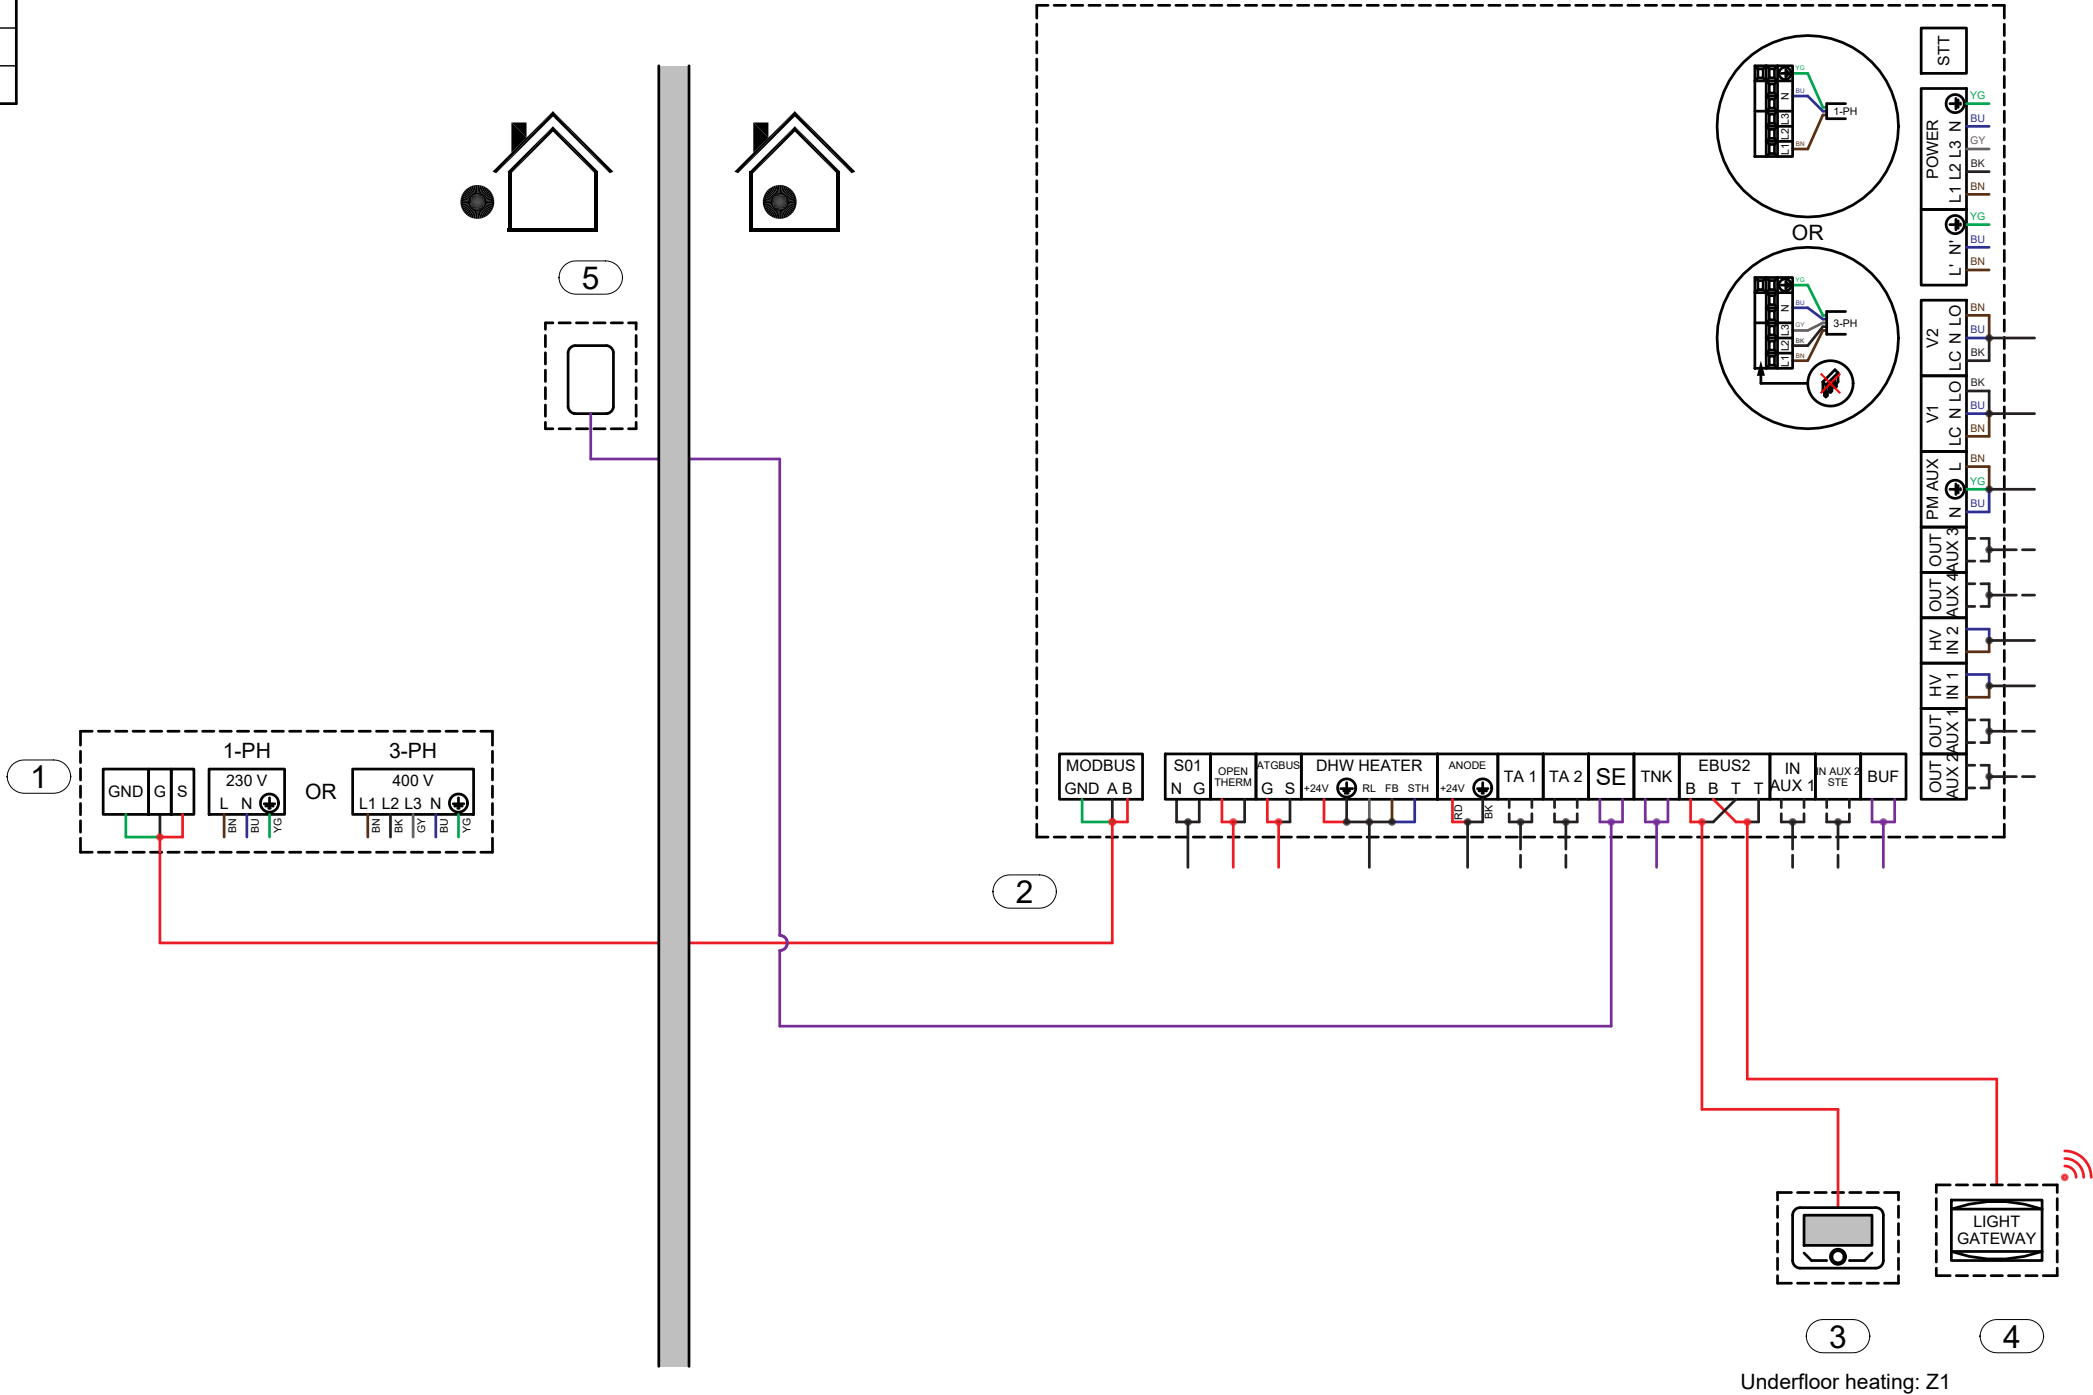
































- This schematic has to be considered as example of the system functionality only and does not replace design by a qualified technician;
- The final schematic must be prepared respecting all the laws, norms and decrees in force, in order to facilitate a correct installation in compliance with the rule of the art;
- For the proper functioning of all system components, follow the instructions in the design, installation and user manuals provided by the manufacturer;
- This outline may be amended by the Ariston Group at any time without prior notice.







SCHEME		
Electrical		
DATE	REV.	PAGE
05/12/2023		2 / 4

SCHEME NAME

EN\_003\_PCM4.PL.S\_HC\_1D

Legend	
Hydraulic	
	Hot water
	Cold water
	DHW hot water
	DHW cold water
	DHW mixed water
	DHW recirculation water
	Refrigerant fluid
	Gas connection
	Electric connection
Electric	
	BN Brown (L1)
	BU Blue (N)
	YG Yellow green (PE)
	BK Black (L2)
	GY Grey (L3)
	RD Red
	Dry contact
	BUS connection
	Generic signal
	Sensor signal

Legend	
Hydraulic components	
	2-WAY VALVE
	CIRCULATOR GENERIC
	BY-PASS VALVE
	MAGNETIC FILTER
	DISCHARGE
	POLYPHOSPHATE FEEDER
	SAFETY VALVE
	SYPHON
	NON RETURN VALVE
	SHUT-OFF VALVE
	THERMOSTATIC MIXING VALVE
	BALANCING VALVE

Legend	
Drawing symbols	
	INLET OR OUTLET AIR BLUE
	INLET OR OUTLET AIR RED
	COOLING
	HEATING
	HEATING-COOLING
	WIFI

- This schematic has to be considered as example of the system functionality only and does not replace design by a qualified technician;
- The final schematic must be prepared respecting all the laws, norms and decrees in force, in order to facilitate a correct installation in compliance with the rule of the art;
- For the proper functioning of all system components, follow the instructions in the design, installation and user manuals provided by the manufacturer;
- This outline may be amended by the Ariston Group at any time without prior notice.

MENU	N° PARAMETER	NAME	DESCRIPTION-OPTIONS	VALUE TO BE SET	RANGE	DEFAULT
HHP Energy Manager	1.0.0	IDU type	Defines the type of the internal unit: 0 = None   2 = Hydraulic module   3 = Light	2 = Hydraulic module	[0-3]	2
	1.0.1	ODU type	Defines the type of the outdoor unit: 1 = Heat Pump	1 = Heat pump	1	1
	1.0.2	Tank management	In case of DHW tank, to set which kind of sensor the DHW charge is managed through: 0 = None   1 = Storage with NTC   2 = Storage with Thermostat	0 = None	[0-2]	0
	1.1.8	System flow T selection	Defines which kind of device is used by the product to determine flow temperature to system: 0 = HP water flow temp   1 = System flow T	1 = System flow T	[0-1]	1
	1.8.0	Cooling mode activation	Activates the cooling mode: 0 = Not active   1 = Active	Up to user	[0-1]	0
Zone 1 parameter (For all thermoregulation parameters refer to the installer manual)	4.8.3	Heating Controller	Define with which device the heat request is performed 0 = None 1 = Room thermostat (Thermostat connected to TA1 of Energy Manager) 2 = Room sensor (Room sensor on eBus2)	2 = Room sensor	[0-2]	2
	4.8.4	Cooling controller	Define with which device the heat request is performed 0 = None   1 = Room thermostat   2 = Room sensor	If the cooling mode is active (1.8.0 = 1) set: 2 = Room sensor	[0-2]	2
		User Menu/Zones Management	Define the operation mode of the zone: - Off (heat request inhibited) - Manual (setpoint temperature for the zone is maintained for 24h) - Time program (setpoint temperature of the zone follows the hourly programme profile. In case of Room thermostat, the reduced temperature level inhibits the heat request)	Up to user		
	4.2.9	Heat request mode	Define the Heat request mode for the zone 0 = Standard 1 =RT time program exclusion (In case of Room thermostat, the reduced temperature level doesn't inhibit the heat request) 2 = Forcing heat demand (Heat request always true)	Up to user	[0-2]	0

SOFTWARE COMPATIBILITY	
New Sensys	Starting from 00.07.12
EM2.0	Starting from 22.05.27
TDM	Starting from 21.01.186

- This schematic has to be considered as example of the system functionality only and does not replace design by a qualified technician;
- The final schematic must be prepared respecting all the laws, norms and decrees in force, in order to facilitate a correct installation in compliance with the rule of the art;
- For the proper functioning of all system components, follow the instructions in the design, installation and user manuals provided by the manufacturer;
- This outline may be amended by the Ariston Group at any time without prior notice.